

August 2006

Promat



Tunnel Fire Protection

A lost formwork system, using PROMATECT®-H



The Palm Jumeirah Development, Dubai, United Arab Emirates

www.promat-tunnel.com

LOST FORMWORK SYSTEM, PROMATECT®-H

Contents

1. Project Background	3
2. Companies Involved	4
3. Technical Specification and Requirements for Fire Protection of Structural Concrete	5/7
4. Promat Technical Offer	8/17
5. Installation Guide and Experiences	18/20
6. Project References in Lost Formwork Application	21
7. Acknowledgement and Reference List	22
8. PROMATECT®-H Technical Data Sheet for The Palm Jumeirah Tunnel, Dubai	23

This brochure describes the use of Promat fire protection lining boards installed on the tunnel project on The Palm Jumeirah.

The photographs on the cover page and pages 2 and 3 of this brochure are reproduced courtesy of the Taisei Corporation.



LOST FORMWORK SYSTEM, PROMATECT®-H

1. Project Background

The Palm Jumeirah development on the coast of Dubai is a man-made island in the shape of a palm tree extending into the Arabian Gulf.

The project was launched in 2001 with reclamation starting the same year. Approximately 100 million cubic meters of sand were placed to form the The Palm Jumeirah, which consists of a main trunk with a total of 17 fronds extending each side, all being encircled by a Crescent, which forms a breakwater. The island extends 5 kilometres into the Arabian Gulf area and is 5 kilometres wide.



The Crescent is connected to the trunk by a 1.4 kilometre long cut and cover, sea-crossing tunnel. In addition to vehicular traffic, a mono rail system is being constructed from the Gateway station for the entire length of the island's trunk to the Atlantis station with two intermediate stations. On completion, The Palm Jumeirah which is envisaged to be one of the world's premier living and tourism destinations, will contain a total of approximately 1540 villas in a number of distinctive styles. There will also be 20 shoreline apartment buildings of 13/14 levels containing a mixture of 1, 2 and 3 bedroom units, totalling approximately 2500 apartments. In addition to this there will be 4 large marinas and over 30 of the world's top hotels.

LOST FORMWORK SYSTEM, PROMATECT®-H

2. Companies Involved

NAKHEEL – PROPERTY DEVELOPER

The project developer for The Palm Jumeirah is Nakheel, the Middle East's leading property development company.

As the developer of more than \$30 billion of real estate in Dubai, Nakheel has been instrumental in turning Dubai into one of the fastest growing cities in the world, and a world class destination for business and tourism. In addition to The Palm Jumeirah, Nakheel is developing two other palm shaped islands, The World – 300 islands in the shape of the world – and Dubai Waterfront, the world's largest waterfront development and a number of large scale inland developments.

PARSONS BRINCKERHOFF - PROJECT MANAGEMENT CONSULTANTS

One of the leading transportation engineering companies in the world providing design, construction and programme management world-wide and specialising in transit systems, tunnels, bridges and airports.

PARSONS DE LEUW CATHER - SUPERVISING CONSULTANTS

Internationally renowned consultants on roads and highways, transportation systems, bridges and tunnels.

TAISEI CORPORATION - DESIGN AND BUILD MAIN CONTRACTOR

One of the largest Japanese construction and engineering companies working on major projects world-wide. Taisei appointed Halcrow International Partnership as their design partners.

Comments by Mr Akihiko Mochizuki, Project Manager for Taisei Corporation. Main Contractor, The Palm Jumeirah tunnel project.

“ We ordered PROMATECT®-H boards in October 2005, with a schedule of required deliveries to meet our construction programme through to mid-2006. The boards were received on, or before, our required dates.

The boards were well packed and protected and no transit damage was experienced.

We decided to set up a dedicated storage/workshop area on site, where we could prepare the boards prior to installation. This area was manned by a team of men who prepared and cut the boards. The same team was also responsible for installation.


Promat sent two engineers to site during our first few days of the project to give advice to our installation team. Promat continued with periodic on-site advice during the project.

The PROMATECT®-H boards were supplied accurately cut and finished within the required dimensional tolerances.

Our installation team found the boards easy to handle and place, as proved by the improved production and installation rate.

The key point of the installation was the curved section, where each row of boards was placed on plywood in the workshop area and cut in one go. This resulted in minimising the gap between the boards as a result of Promat's and Taisei's idea.

The finished lining to the tunnel provided a pleasant appearance with minimised gaps between boards. ”

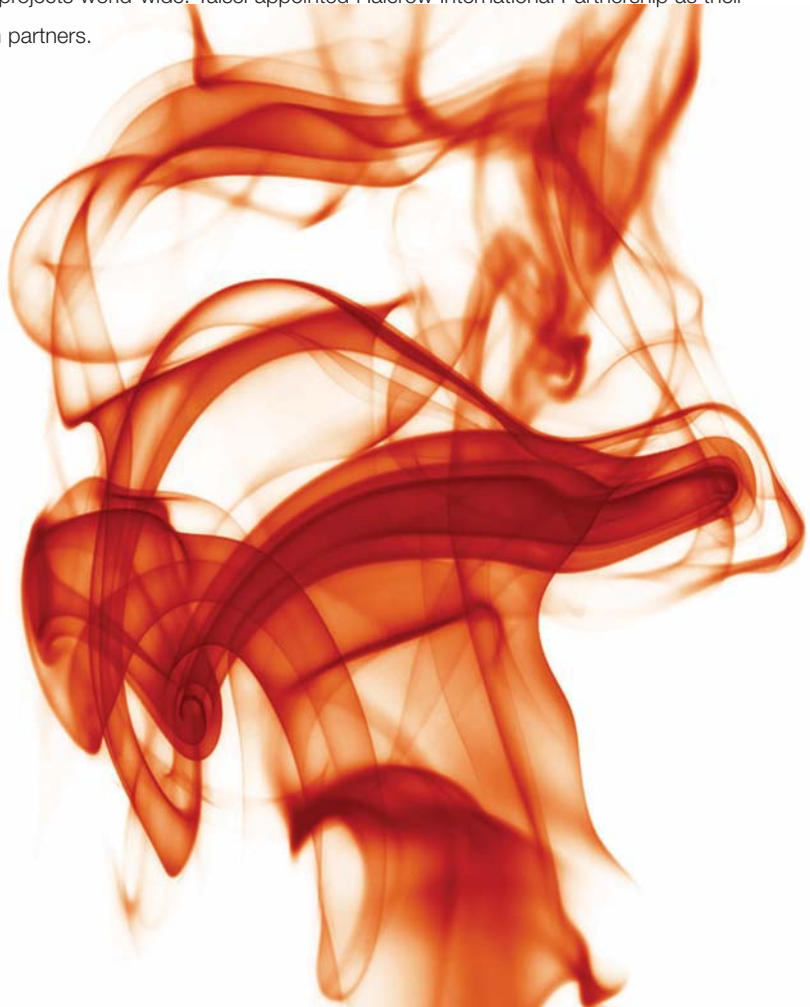

LOST FORMWORK SYSTEM, PROMATECT®-H

3. Technical Specification and Requirements for Fire Protection of Structural Concrete

3.1. REASONS TO PROJECT A CONCRETE TUNNEL AGAINST FIRE

Concrete tunnels are vulnerable to elevated temperatures caused by fire. Tests have shown that when the temperature of the reinforcement reaches 300°C, the bond between the rebar and concrete will be significantly reduced, leading to irreparable sagging and possible collapse of the total structure. Moreover, when concrete is exposed to fire temperatures as experienced in tunnels, concrete spalling often occurs.

Spalling is an umbrella term, covering different damage phenomena that may occur to a concrete structure during fire. These phenomena are caused by different mechanisms: pore pressure, thermal gradient, internal thermal micro-cracking, cracking around reinforcement bars and strength loss due to chemical transitions. In different combinations of these mechanisms, possible spalling phenomena include violent spalling, progressive gradual spalling, explosive spalling, corner spalling and post-cooling spalling [1]*.

The Palm Jumeirah tunnel is constructed using a C40 concrete grade, which was cast in place. If left unprotected, such concrete would typically suffer from violent spalling if it was exposed to a typical tunnel fire, which creates temperatures up to 1200°C within only 5 minutes. Violent spalling is the separation of small or larger pieces of concrete from the cross section, during which energy is released in the form of popping off of the pieces and small slices with a certain speed, and also a popping or cracking sound. This type of spalling is caused by pore pressure and thermal gradients [1]*.

* Refer to 'References List' on page 22.



Severe concrete spalling after fire exposure in tunnel


LOST FORMWORK SYSTEM, PROMATECT®-H

3. Technical Specification and Requirements for Fire Protection of Structural Concrete

3.2. DEFINITION OF DESIGN FIRE CURVE

In the late 1970's the Dutch Ministry of Transport, Rijkswaterstaat (RWS), contemplated the structural safety of their immersed tunnels in case a large fire would occur.

In co-operation with TNO Centre for Fire Safety in the Netherlands, a series of small-scale tests were carried out, which resulted in the time-temperature curve as we now know as the RWS fire curve.

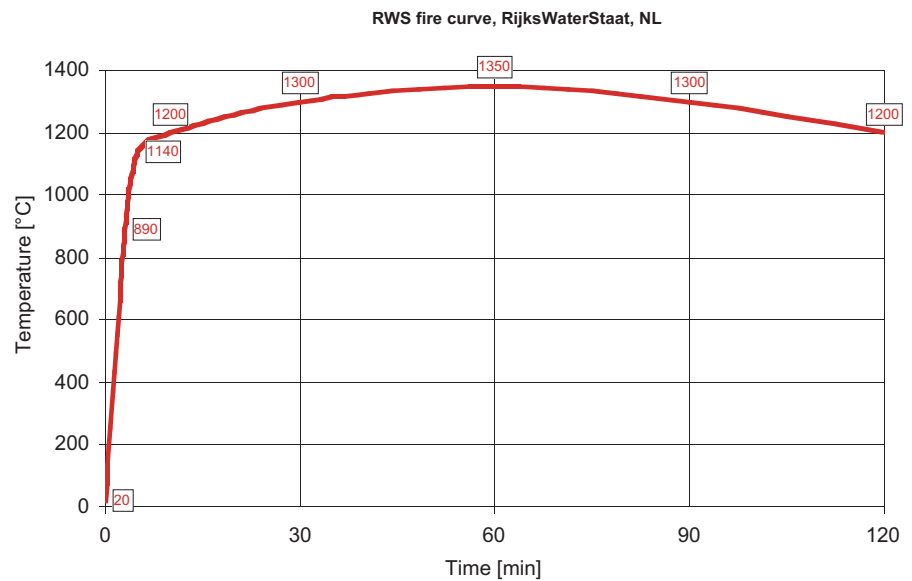

RWS fire curve, 120 minutes as applied in The Palm Jumeirah tunnel

Test nr.	Description of the fire load in Runehamar tests	Total weight (kg)
1	360 wood pallets measuring 1200 x 800 x 150mm 20 wood pallets measuring 1200 x 1000 x 150mm 74 PE plastic pallets measuring 1200 x 800 x 150mm	10911
2	216 wood pallets 240 PUR mattresses measuring 1200 x 800 x 150mm	6853
3	Furniture and fixtures (tightly packed plastic and wood cabinet doors upholstered PUR arm rest, upholstered sofas, stuffed animals, potted plant (plastic), toy house of wood, plastic toys). 10 large rubber tyres (800kg)	8500
4	600 corrugated paper carton with interiors (600 x 400 x 500mm) and 15% of total mass of unexpanded polystyrene (PS) cups (18000 cups) and 40 wood pallets (1200 x 1000 x 150mm)	3120

The worst case scenario was defined as a 50m³ petrol tanker that would catch fire in the tunnel, creating a pool-fire size of some 150m² and lasting 120 minutes. Such a fire would create a heat release rate of 300MW. Years later, the accuracy of this fire curve was confirmed by the Eureka tests, BRE and the Memorial Tunnel tests in the USA. In the frame of a Swedish national and a European research program on tunnel safety (UPTUN), comprehensive large scale fire tests have been carried out in the abandoned Runehamar road tunnel in the western part of Norway in September 2003.

In the 4 tests that were conducted during this project, the RWS curve was confirmed to be the right choice

as a design fire curve for tunnels. Even with very limited fire loads temperatures reached up to 1250-1350°C.

It should be noted that all combustible materials, which were used in these tests, are not listed as hazardous/dangerous. Products like petrol, paints, resins etc were not used as combustibles. A fire in a truckload of pallets (test 1) made the gas-temperatures rise up to 1365°C. A small truckload of plastic cups in cardboard boxes (test 4) created gas-temperatures of over 1200°C.



LOST FORMWORK SYSTEM, PROMATECT®-H

3. Technical Specification and Requirements for Fire Protection of Structural Concrete

Working Group 6 of the ITA (International Tunnelling Association), focussing on Maintenance and Repair of tunnels, has adopted the complete Runehamar report as mentioned under [2]*. They included the Runehamar report in their final document [3]*, thus acknowledging the conclusion that the RWS curve is the right choice as a design fire curve for tunnels.

Based on the information opposite and conducted research from all over the world, the developer decided to apply the highest and safest available standards for fire protection of tunnels to the The Palm Jumeirah tunnel: the RWS requirements.

3.3. THERMAL PERFORMANCE CRITERIA

The Dutch Ministry of Transport, Rijkswaterstaat (RWS), in close co-operation with TNO, Centre for Fire Research in The Netherlands has issued a test procedure for fire protection of tunnels [4]*.

As described in section 6.1 of this procedure, the thermal performance should comply with the following criteria:

When spalling is not decisive during the 2 hours heating period the following temperature values shall not be exceeded:

- a) 380°C for each measuring point in the interface concrete/protective material;
- b) 250°C for each measuring point at 25mm above the bottom of the concrete slab (thermocouples fixed to the under side of the reinforcement).

During the 2 hours heating period, the material must not fall down as a result of failure of the offered fixing system.

* Refer to 'References List' on page 22.



Towards an improved use of underground space

INTERNATIONALE ASSOCIATION ITA
DES TRAVAUX EN SOUTERRAIN AITES INTERNATIONAL
TUNNELING ASSOCIATION

In Consultative Status, Category II with the United Nations Economic and Social Council
<http://www.ita-aites.org>


International Tunneling Association
Association Internationale De Travaux En Souterrain

GUIDELINES FOR STRUCTURAL
FIRE RESISTANCE
FOR
ROAD TUNNELS

DIRECTIVES POUR LA RESISTANCE AU
FEU DES STRUCTURES DE TUNNELS
ROUTIERS

BY
Working Group No.6 Maintenance and Repair
Groupe de Travail N° 6 Entretien et Repaire
May, 2004

International Tunneling Association, WG-6 document

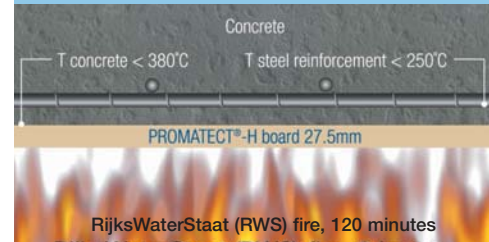

RijkswaterStaat (RWS) fire, 120 minutes

Protected concrete specimen
and RWS temperature criteria

LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

4.1. THERMAL PERFORMANCE OF PROMATECT®-H BOARDS


Promat conducted several fire tests at TNO Centre for Fire Research which proved that the system meets the specifications as defined in the RWS test procedure.

The conclusion of these tests is that 27,5 mm PROMATECT®-H boards will provide sufficient insulation to the concrete structure to meet the RWS requirements as listed in paragraph 3.3.

The graphs below indicate the thermal performance of 27,5 mm PROMATECT®-H boards when applied for concrete protection [5]*. As can be seen, the recorded temperatures on the interface (approximately 320°C) and the reinforcement (165°C) are well below the RWS criteria of 380°C and 250°C respectively.



TNO Efectis Netherlands: largest RWS-fire capable furnace in Europe

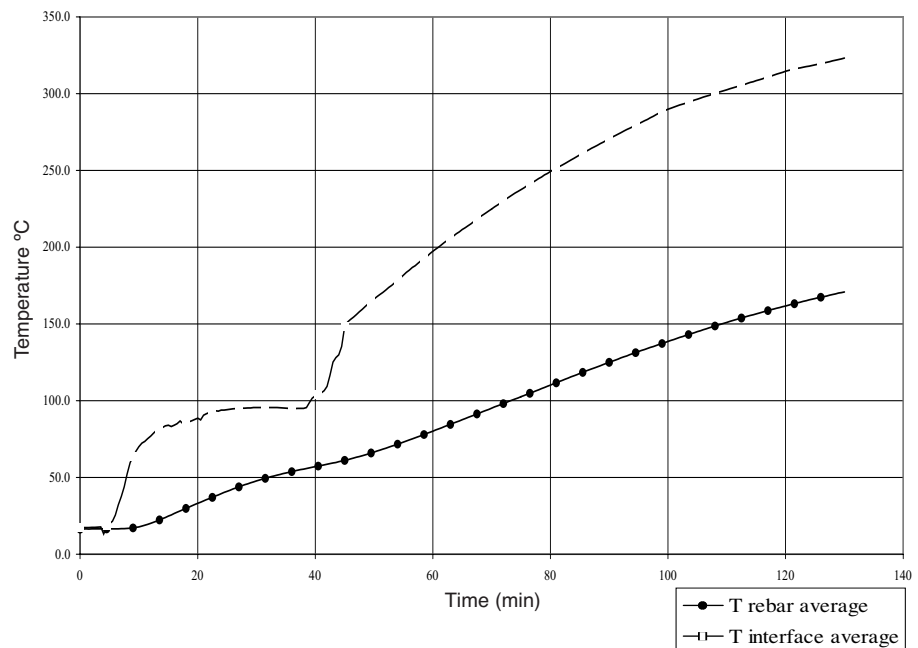

Thermocouple recordings during the fire

* Refer to 'References List' on page 22.



LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

4.1.1. PROMATECT®-H CEILING SYSTEM, LOST FORMWORK METHOD

In this project the PROMATECT®-H boards in the ceiling were applied using the lost formwork method. Basically this system consists of the following installation steps:

1. The boards are laid on the load-bearing formwork


The PROMATECT®-H boards will be laid with the smooth face down (see drawing A), as this will provide the fair faced finish after completion of the tunnel.

It is very important to align the first row of boards preferably alongside a ruler or a strip of plywood, which is screwed to the formwork. The rest of the boards are laid next to each other, with butted joints, utilising the previous row as the next ruler. No special treatment on the joints is required (see photographs B, C and D).

Where the tunnel is designed with sloped sections, so called haunches, the edges of the boards are simply cut under an angle and installed butt-jointed (see photograph E).

In order to minimise tolerances by cutting on the job site, there are two options. One is to lay the boards on the formwork, draw the cutting line (for example at the end of a section) and cut all boards in one go alongside a ruler on the formwork. The second option is to pre-cut the boards in a dedicated workshop on site. This second method was used by Taisei and has proven its accuracy, based on the minimised gaps between the boards.

The boards can either be installed using staggered joints or straight joints. Experience from contractors has learned that the staggered joint method results in less gaps in between the boards, as this method allows to compensate for certain tolerances, whereas the straight joint method does not allow for much compensation. For The Palm Jumeirah tunnel, Taisei chose to lay the boards with straight joints.

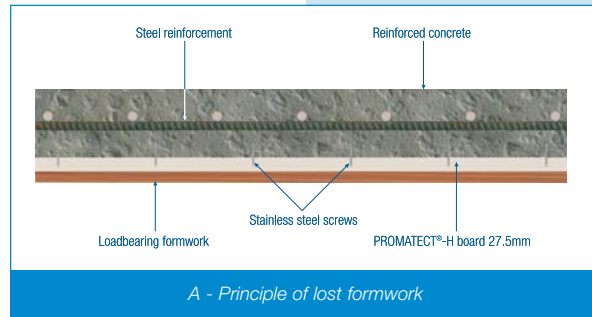

LOST FORMWORK SYSTEM, PROMATECT®-H


4. Promat Technical Offer



F - The screw locations are pre-marked on the boards



G - First layer on reinforcement installed, prior to inserting the screws

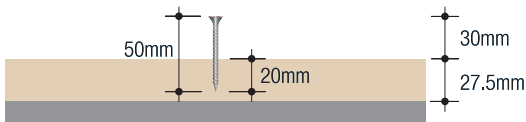

H - Principle of screw insertion



I - Insertion of the screws



J - Screw installed and protected by reinforcement

The locations of the screws are marked on the boards, using a template and a spray-can with red paint (see par. 5.1.), (photograph F).

2. The first layer of reinforcement is installed

Prior to the installation of the stainless steel screws, the first layer of reinforcement is installed on the stools (spacer blocks creating concrete cover). In this way the screws are always protected from people stepping on them (see photograph G).

3. Stainless steel screws are partly inserted in the PROMATECT®-H boards

The 50mm long screws (as detailed on page 13) are inserted to a depth of 20mm, through the openings in the reinforcement; the remaining 30mm sticks out of the board creating the anchorage to the concrete after it has been poured (see drawing H).

Several methods are available on the market for ease of installation of the stainless steel screws (see photographs I and J):

- Battery-driven drilling machines can be equipped with depth guiding devices to ensure the correct drilling depth of 20mm.
- Screws can be supplied on a plastic strip, which is fed into the drilling machine, increasing the installation speed.
- Battery-driven drilling machines can be equipped with a tube through which the screw can be dropped down onto the surface of the board. The installer can remain standing upright while installing the screws.



LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

4. The concrete is poured

Before the concrete is poured, the PROMATECT®-H boards can be hosed down to remove the accumulated site debris and to humidify the boards to prevent that water is extracted from the concrete mixture. Excessive water should be removed from the surface of the boards prior to the pouring of the concrete (see photograph K). During vibration of the concrete, the machinery being used should be kept away from the surface of the PROMATECT®-H boards.

5. After the concrete is sufficiently cured the formwork will be extracted

As there is no adhesion between the concrete and the formwork, it will be easy to extract the formwork and it remains clean (see photograph L).

The following advantages of the PROMATECT® H lost formwork system have been reported by contractors over the years:

Formwork savings:

- The shuttering material only has to have load-bearing properties. There is no need to apply phenol coated plywood boards as the PROMATECT®-H boards will be laid on top of the formwork. The formwork elements just have to be installed properly (flush).
- As the concrete will not be in direct contact with the formwork, there is no need for de-moulding oil (no slippery surfaces). The plywood sheets will remain clean and can be re-used.
- Formwork can be installed at a distance of up to 90mm from the side walls. The PROMATECT®-H boards can span that distance, depending on the expected load. At this location, care should be taken with the vibrating action during pouring of the concrete. Extraction of the formwork is much easier as it will not get stuck between the walls.
- As there is no adhesion between the concrete and the formwork, it is easy to extract the formwork



K - The pouring of the concrete



L - Extracted formwork. Flush finish of the ceiling



Regular load bearing plywood can be applied, instead of phenol coated plywood



Cutting the boards on the formwork eliminates the tolerances



Wall panels can also be installed using the lost formwork method



Distance between formwork and wall, easing the extraction of the formwork

LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

Ease of installation:

- Joints in between boards only have to be butt-jointed. No special treatment such as filler or mastic is necessary from a fire performance point of view. The cement water will not run through the joints. Where gaps of more than 1mm occur, mastic can be used to seal the gap in order to prevent that cement water would leak through the gap, causing an unsightly stain.
- The vertical wall panels can also be installed using the lost formwork system
- Curves in the tunnel can easily be dealt with by cutting the boards on the formwork
- Openings in the PROMATECT®-H lining (for manholes and end-walls) can easily be made by installing a phenol coated formwork panel instead. Afterwards standard size PROMATECT®-H boards will close the opening by post-fixing the board into the opening.
- PROMATECT®-H boards provide a heavy-duty floor surface. The abrasion resistance is such that the surface can withstand the exposure to people walking and working on top of it, even in wet conditions. Also, the weight of bundles of reinforcement steel and pallets in excess of one tonne will not cause any damage to the boards.
- Rapid installation method. Installation rates for the PROMATECT®-H boards of 150m² per man per day have been reported on European tunnel projects.
- The installation of the system does not interfere with other construction activities.
- Extensive experience is available with this system in immersed and cut and cover tunnels

Tunnel services and special shapes:

- Anchor systems (i.e. jet-fans) can be fixed on the boards, prior to casting the concrete
- Services, pipes, tubes etc. can be included
- After the formwork is extracted, services can be installed on the PROMATECT®-H lining from below. Anchors can be installed through the boards into the concrete, thus providing a continuous fire protective layer.
- Special shapes in the concrete structure can easily be made (i.e. beams)

Other:

- As the PROMATECT®-H boards are installed in the very early stages of the construction of the tunnel, it provides fire protection during the construction phase.
- The PROMATECT®-H lost formwork system provides a flush finish of the ceiling. No obstacles like anchor-heads.



Openings for manholes can easily be made by using phenol coated plywood panels



Inclusion of services and pipes in formwork



Anchors for services are installed through boards into the concrete, thus creating a continuous fire protective layer



Special shapes in the concrete can easily be made



LOST FORMWORK SYSTEM, PROMATECT®-H


4. Promat Technical Offer

4.1.1.a. SCREW MODEL DESCRIPTION

The applied screws for the lost formwork system are 5.0 x 50 mm chipboard screws, with a countersunk (CSK) head type and a pozidrive-2 connection. These screws were applied in a stainless steel grade A2 (1.4567). See par. 4.1.3 for more details on this.

Dimensional details of this particular screw can be found in the below table and drawing.

Code	Description	Dimension (mm)	Tolerance
L	Length	50	-
Lv	Length of winding	44	+/- 1,5 mm
Lt	Length of serrated winding	29	+/- 1,5 mm
d1	Threat diameter	5,0	+0,2 -0,35 mm
d2	Shaft diameter	3,05 - 3,45	-
dk	Head diameter	9,7	+0 -0,5 mm
P	Winding distance	2,5	+/- 10%
k	Connection depth, Pozidrive-2	2,6 - 3,0	-
m	Connection width	5,3	-

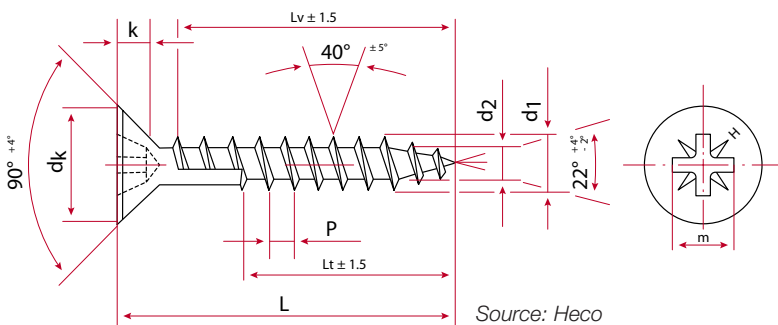

The design of a screw has major influence on the mechanical performance and fire performance, in combination with PROMATECT®-H boards. Among others, properties like shaft-diameter versus thread-diameter, sharpness of the tip and distance of the winding (thread) will influence the stickability of the screws and the performance of the final system.

The above mentioned screw type has been tested to its pullout resistance when partially (20 mm) inserted into dry as well as water saturated (worst case) 27,5mm PROMATECT®-H boards [6]*. Even when tested in water saturated conditions the minimum-recorded screw pullout strength was in excess of 500N, which was satisfactory for the client. In dry conditions the maximum-recorded screw pullout strength exceeded 725N.

Similar screws as described above have also been used in a lost formwork system in a fire test at TNO where PROMATECT®-H boards have been exposed to the RWS fire curve for 120 minutes, without any mechanical or thermal failure [7]*.



LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

4.1.1.b. TUNNEL EXPANSION JOINTS

The expansion joints are kept watertight by means of a rubber profile which is embedded in the concrete. During the lifetime of the tunnel an expansion joint can create a gap of up to a maximum of 35mm as a result of thermal movement of the tunnel. This could potentially cause a thermal leak in case of fire as the PROMATECT®-H boards will follow the movement of the structural concrete it is mounted on. In order to address this, cover strips of the same PROMATECT®-H 27,5 mm material are installed behind the joints and are fixed with stainless steel screws to one side. In this way a potential gap in between the boards, at the location of the expansion joint, is always closed and the fire performance is secured.



Detail of an expansion joint and cover strip allowing movement

4.1.2. PROMATECT®-H WALL SYSTEM, POST-FIXED METHOD

Just like the ceiling system, the wall panels can also be installed as a lost formwork system. The boards are temporarily connected to the vertical formwork by means of 4 screws per panel. The anchorage of the PROMATECT®-H board to the concrete is again done by means of partially inserted screws.

For the Palm Jumeirah tunnel it was decided to install the wall panels after the walls had been constructed. The boards were installed by means of stainless steel anchors, creating fire protection over a height of 1200mm on the wall. The boards were anchored to the concrete, butt jointing one board next to the other. The reason for protecting the top section of the wall is that the bending moment in the roof introduces compression stresses into the upper part of the wall. Research has proven that concrete that is exposed to compression stress is more vulnerable to fire exposure (spalling), as opposed to neutral (non-loaded) or tensioned concrete.

4.1.2.a. ANCHOR MODEL DESCRIPTION

The selected anchor type is the Fischer FNA 6x30/30 A4. These anchors were applied in a stainless steel grade A4 (1.4401). See par. 4.1.3 for more details on this.

The FNA anchors are installed in combination with a circular washer, diameter 30mm, thickness




Fischer FNA anchor and washer

Code	Description	Dimension (mm)
d_o	Anchor diameter	6
l	Length	68
h_{ef}	Effective anchorage depth	30
t_{fix}	Effective length	30
d	Diameter of nailhead	13

1,2mm stainless steel grade A4 and a hole diameter of 7,5mm.

This FNA anchor, including the washer, was tested at TNO, Centre for Fire Research in RWS fire conditions for 120 minutes in combination with the 27,5mm PROMATECT®-H boards and passed the test, without any mechanical or thermal failure [5]*.

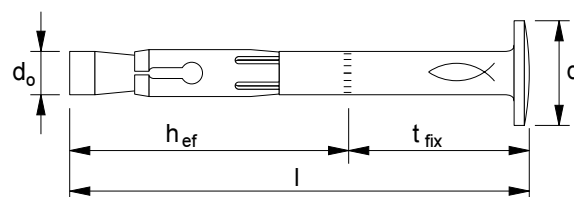

Source: Fischer

* Refer to 'References List' on page 22.



LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

The aforementioned anchor type, including the washer, has also been tested for its pull-through resistance when installed in dry and water saturated (worst case) 27,5mm PROMATECT®-H boards [8]*.

Even when tested in water saturated conditions the recorded anchor pull-through strength was in excess of 2400N, which was satisfactory for the client. In dry conditions the recorded anchor pull-through strength exceeded 3300N.

In general, when selecting anchors for the installation of fire protective boards in tunnels, following items should be considered:

- Preferably M6 in diameter, to avoid heat sink into the concrete in case of fire
- Made of stainless steel. Grade in function of local tunnel environment (see par. 4.1.3.)
- Of appropriate length to secure the panel, depending on the panel thickness
- Expansion action of the anchorage shall be within the concrete and not in the PROMATECT® panel.
- Can be supplied with a nut and washer head to facilitate removal of the PROMATECT® panels where required.
- Suitable for use in the tension zone of concrete (cracked concrete).
- Suitable for use where the bolts will be subject to positive and negative pressure fluctuation.

4.1.3. CORROSION RESISTANCE OF FIXATION MATERIALS, STAINLESS STEEL GRADES

As described in par. 4.1.1.a. and 4.1.2.a. the fixation materials for the installation of the PROMATECT®-H boards are made out of stainless steel.

Item	Group	Material	DIN	AISI	Chemical Composition							
					C	Si	Mn	S	Cr	Mo	Ni	Cu
Post fixed wall: Fischer anchor FNA 6x30/30	A4	1.4401	X4CrNiMo17-12-2	316	0,04	0,50	1,00	0,015	17,50	2,25	12,00	-
Lost formwork ceiling: Screw 5 x 50mm	A2	1.4567	X3CrNiCu18-9-4	304 Cu	0,03	0,50	1,00	0,015	18,00	-	9,00	3,50

The above mentioned stainless steel grades were also used for the fire tests and mechanical tests. In general, the corrosion resistance of fixing materials for fire protective boards in a tunnel should be checked with the fixing supplier as to the suitability of application in the specific environmental conditions of the tunnel project it is meant for.

* Refer to 'References List' on page 22.

LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

4.2. DYNAMIC LOAD EXPOSURE ON THE FIRE PROTECTIVE LINING

When the tunnel is in operation and traffic passes through the tunnel, the tunnel lining gets exposed to air pressure/de-pressure fluctuations (dynamic loads) especially from trucks. The de-pressure loads in particular can cause integrity problems to fire protective linings. Several tests were conducted at the Technical University of Braunschweig, Germany in order to judge the behaviour of both the lost formwork system (ceiling) as well as the post-fixed system (wall) [9]*.

4.2.1 DYNAMIC LOAD ON LOST FORMWORK SYSTEM (CEILING)

When concrete is poured on the surface of PROMATECT®-H boards, the boards will absorb some cement water creating additional adhesion of the boards to the concrete surface. This effect results in an increased stickability of the boards, as these are not relying on the screws only. However, during the lifetime of the tunnel the adhesion effect of the cement water could decrease, as a result of movement of the tunnel tube and temperature differences. In that case the boards are again relying on the pullout strength of the screws, when the lining gets exposed to dynamic loads.

In order to simulate this worst case scenario, dynamic load tests were conducted using a polyethylene foil at the interface, in between the PROMATECT®-H boards and the concrete, to avoid the adhesion effect [9]*. The whole system was exposed to dynamic loads of up to +/- 3 KPa, which is approximately 3 times the load expected in practice. No mechanical failures or any damage to the boards were recorded. The deflection between the screws was less than 1/15.000 of the span.

4.2.2. DYNAMIC LOAD ON POST-FIXED SYSTEM (WALL)

27,5 mm thick PROMATECT®-H boards were also tested to dynamic loads when post-fixed to a concrete slab, using 3,8 anchors per m², in combination with a 30mm circular washer [9]*. This average of 3,8 anchors per m² is even less than the 4,5 to 5 anchors per m² which are applied in practice. The system was exposed to respectively 3, 4 and 5 KPa. The maximum deflection at 5 KPa was recorded at 1/1.500 of the span between the anchors. No mechanical failures or any damage to the boards were recorded.

4.3. SURFACE QUALITY AND CLEAN-ABILITY

The standard appearance of PROMATECT®-H is a white to off-white colour, having diffuse light reflectance properties, suitable for tunnel linings. When properly maintained the surface can be cleaned by means of professional washing equipment. The abrasion resistance of the surface is such that it will withstand the cleaning action of the brushes.

* Refer to 'References List' on page 22.

LOST FORMWORK SYSTEM, PROMATECT®-H

4. Promat Technical Offer

4.4. DIMENSIONAL TOLERANCES OF PROMATECT®-H BOARDS

The dimensions of each tunnel section in the ceiling area are approximately 16 x 25 meters. If the dimensional and squareness tolerances on the PROMATECT®-H boards were too large, gaps would occur while laying the boards on the formwork as the tolerances will add up. In order to avoid this effect, PROMATECT®-H boards are cut to tight tolerances in the factory, such that gaps between the boards will be minimised.

Item	Specification	Tolerance
Thickness	Nominal 27,5 mm	Minimum 27,0 mm Maximum 30,0 mm
Length and width	L x W = 2500 x 1250 mm	+/- 1,0 mm on L and W
Squareness	Difference in diagonal lengths	A – B < 1,5 mm
Straightness of edges	Maximum theoretical gap in between two boards	< 1,5 mm


4.5. REPAIR OF MINOR DAMAGES

PROMATECT®-H boards, when installed in a lost formwork system, provide a heavy-duty floor surface. The abrasion resistance is such that the surface can withstand the exposure to people walking and working on top of it, in all weather conditions. However, in practice, minor damage can occur on the jobsite. In case minor surface damages or gaps in between the boards in excess of 2 mm would occur, these would be filled with PROMATECT®-T compound, prior to casting the concrete. This material comes as a dry, white to off white powder made from calcium-aluminium silicates and additives. It will just be mixed with water and is then applied with a spatula.

The PROMATECT®-T compound was tested to RWS conditions for a duration of 120 minutes [10]*. A gap of 10mm width was left open in between two PROMATECT®-H panels of 27,5mm thick. Also two holes of 10mm diameter were drilled into the panels. Both the gap and the holes were filled with the PROMATECT®-T compound, which did not show any integrity failures during and after the fire test. The average interface temperature at the joint (behind the PROMATECT®-T compound) after 120 minutes of RWS fire exposure was 335°C, which is well below the interface criteria of 380°C according to RWS requirements.

See the technical data sheet for more details and installation and application instructions [11]*.

* Refer to 'References List' on page 22.

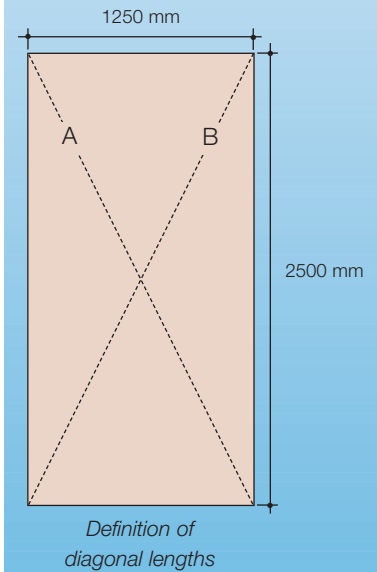

LOST FORMWORK SYSTEM, PROMATECT®-H

5. Installation Guide and Experiences

5.1. CEILING APPLICATION

12 screws per m² were applied during the fire test at TNO, The Netherlands [7]*.

In order to ensure the same fire performance in practice, the exact same set-up as during the fire test should always be followed, including fixing materials.

The screw pattern of a full size board of 2500 x 1250 mm looks as detailed below, providing an average of 12,8 screws per m²:

In The Palm Jumeirah tunnel the PROMATECT®-H boards were supplied in dimensions of

2500 x 1250 mm. The locations of the screws were marked on the boards, using a template and a spray-can with red paint.

The majority of the boards are laid on the formwork in its standard full size dimension. Some panels had to be cut to size in order to cover the whole surface of the formwork and to connect to the walls and construction joints. Where cut to size panels are used, the following criteria should be followed:

- The minimum amount of screws should be 12 screws per m².
- The edge distance should be 50mm
- The screws for cut pieces should be evenly distributed over the surface of the panel. That means that the spacing distances in X and Y direction should be optimised and be as close as possible.


* Refer to 'References List' on page 22.



Template for screw location




Spray can to mark screw location using template

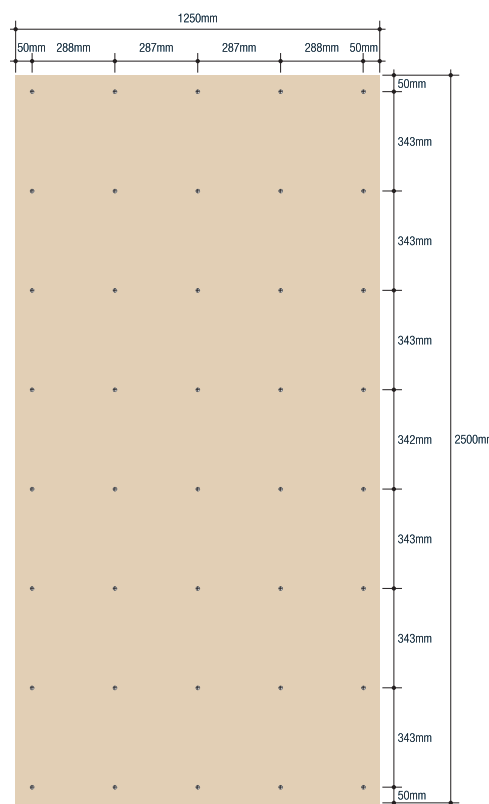



LOST FORMWORK SYSTEM, PROMATECT®-H

5. Installation Guide and Experiences

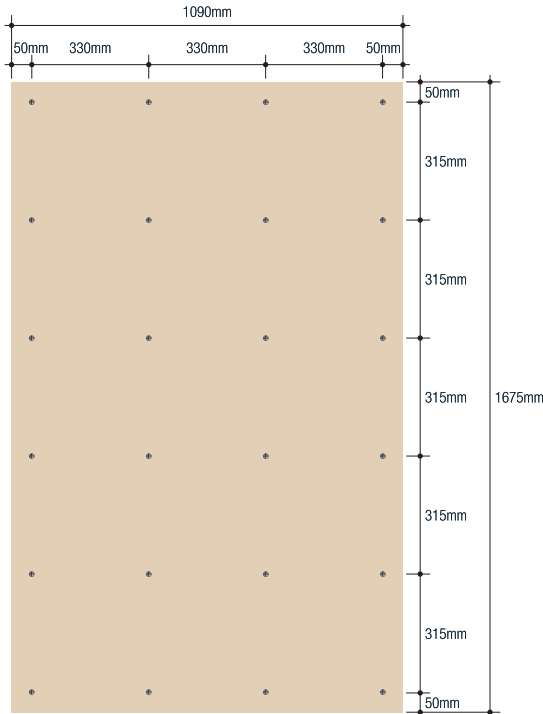


The drawing opposite is an example of a screw pattern on a cut to size panel of 1675 x 1090mm, in which all criteria are followed. The surface area of the panel is 1,83m² which means that the minimum amount of screws should be 22. In this case the total amount is 24 screws and the edge distance of 50mm is followed. The spacing distances are optimised and are almost equal (315 and 330 mm).

5.2. WALL APPLICATION

Post-fixed installation of PROMATECT®-H boards require 4,5 to 5 anchors per m². The anchors will be installed using a circular washer of 30mm diameter, as described in par. 4.1.2.a.


The anchor pattern of a full size board of 2500 x 1250mm looks as follows, having an average of 4,8 anchors per m²:

The majority of the boards are installed against the wall in standard (full size) dimensions. Some panels have to be cut to size in order to connect to the ends of the tunnel element.

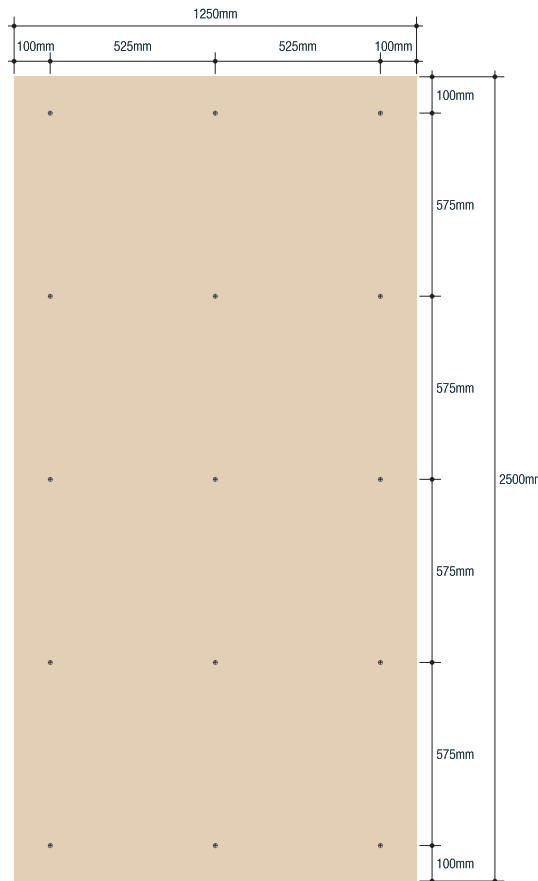

LOST FORMWORK SYSTEM, PROMATECT®-H

5. Installation Guide and Experiences

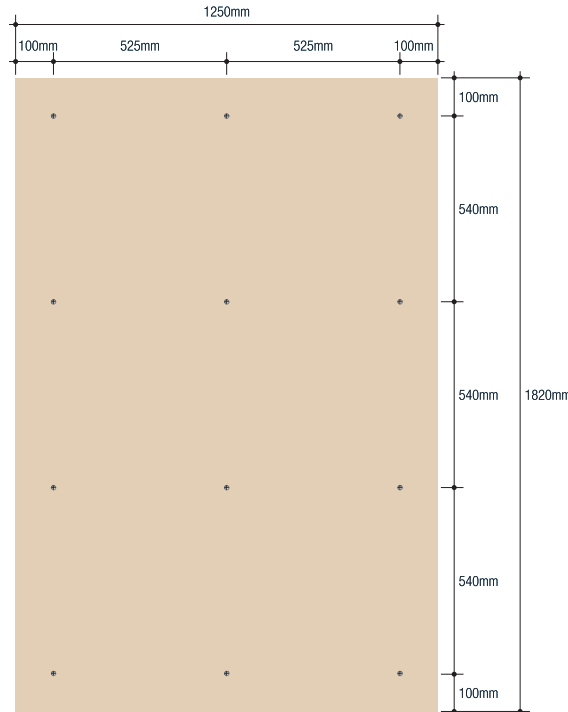

In case of cut to size panels, the following criteria should be followed:

- The minimum amount of anchors should be 4,5 anchors per m².
- The edge distance should be 100mm.
- The anchors for cut pieces should be evenly distributed over the surface of the panel. That means that the spacing distances in X and Y direction should be optimised and be as close as possible.

The drawing opposite is an example of an anchor pattern on a cut to size panel of 1820 x 1250mm, in which all criteria are followed.

The surface area of the panel is 2,28m² which means that there should be a minimum of 11 anchors. In this case, the total amount is 12 anchors and the edge distance is 100mm. The spacing distances are optimised and are almost equal (525 and 540 mm).





LOST FORMWORK SYSTEM, PROMATECT®-H


6. Project References in Lost Formwork Application

Throughout the world, Promat boards have been applied to protect over 120 tunnels against the most severe tunnel fires. Amongst others, the PROMATECT®-H lost formwork system as used in The Palm Jumeirah tunnel was also installed in following reference projects:

Project name	Year of Installation	Country	City	Tunnel Use
Aquaduct Abcoude	2005	The Netherlands	Abcoude	Train
Roer Tunnel	2005	The Netherlands	Roermond	Road
Gotha Tunnel	2003	Sweden	Göteborg	Road
Viaduct Schiphol Airport	2002	The Netherlands	Amsterdam	Road
Caland Tunnel	2002	The Netherlands	Rotterdam	Road
High Speed Line	2002	The Netherlands	Rotterdam	High speed train
Seitwende Tunnel	2002	The Netherlands	The Hague	Road
Elbe Tunnel 4th Tube (ramps)	2001	Germany	Hamburg	Road
2nd Benelux Tunnel	2001	The Netherlands	Rotterdam	Road
City Northern Bypass Tunnel	1998	Australia	Perth	Road
Tunnel under North River	1989	The Netherlands	Hendrik Ido Ambacht	Road
Harbour Tunnel CANA	1989	USA	Boston	Road



Aquaduct Abcoude, Netherlands

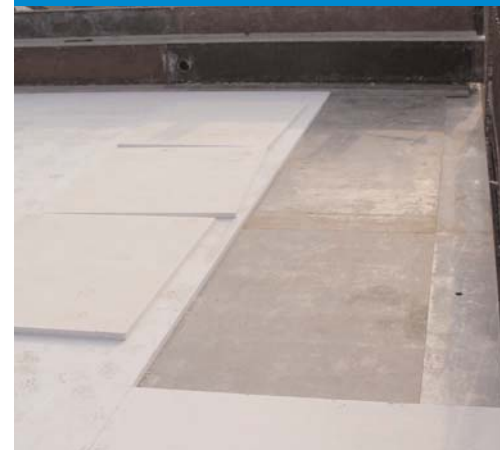

Roer Tunnel, Netherlands



City Northern Bypass Tunnel - Perth, Australia



Harbour Tunnel CANA, USA



Gotha Tunnel, Sweden



Seitwende Tunnel, Netherlands

The authors are grateful to the owner of The Palm Jumeirah tunnel, NAKHEEL, for allowing Promat to issue this document.



LOST FORMWORK SYSTEM, PROMATECT®-H

7. Acknowledgement and Reference List

REFERENCE LIST

- [1] **SPALLING OF CONCRETE AND FIRE PROTECTION OF CONCRETE STRUCTURES**
A. J. Breunese and J. H. H. Fellingner
TNO Building and Construction Research, Centre for Fire Research, Delft/Rijswijk, The Netherlands
- [2] **SUMMARY OF LARGE SCALE FIRE TESTS IN THE RUNEHAMAR TUNNEL IN NORWAY, CONDUCTED IN ASSOCIATION WITH THE UPTUN RESEARCH PROGRAM**
Jan Brekelmans, TNO Building and Construction Research, Centre for Fire Research, René van den Bosch, Promat Tunnel Fire Protection
- [3] **GUIDELINES FOR STRUCTURAL FIRE RESISTANCE FOR ROAD TUNNELS**
ITA, International Tunnelling Association, Working Group No.6 Maintenance and Repair, May, 2004
- [4] **FIRE PROTECTION FOR TUNNELS, Part 1: Fire Test Procedure, 1998-CVB-R1161 (rev. 1)**
TNO Building and Construction Research, Centre for Fire Research, Delft/Rijswijk, The Netherlands
- [5] **DETERMINATION OF THE BEHAVIOUR OF A CONCRETE SLAB PROTECTED WITH CALCIUM SILICATE BOARD TYPE PROMATECT®-H UNDER RWS FIRE CONDITIONS, 2004-CVB-R0115[Rev.1].**
TNO Building and Construction Research, Centre for Fire Research, Delft/Rijswijk, The Netherlands
- [6] **SCREW PULLOUT OF PROMATECT®-H IN DRY AND WATER SATURATED CONDITION**
PRTC, Promat Research and Technology Centre, 30 November 2005
- [7] **DETERMINATION OF THE BEHAVIOUR OF A CONCRETE SLAB PROTECTED WITH CALCIUM SILICATE BOARD TYPE PROMATECT®-H UNDER RWS FIRE CONDITIONS, B-85-191(E)**
TNO Building and Construction Research, Centre for Fire Research, Delft/Rijswijk, The Netherlands
- [8] **PULL THROUGH TEST ON PROMATECT®-H 27,5 MM OF FISCHER FIXATIONS AT060131**
PRTC, Promat Research and Technology Centre, 2 February 2006
- [9] **TESTING OF DYNAMIC LOAD CYCLES IN 27,5 MM PROMATECT®-H BOARDS (German)**
6432/328-Pm/br Technical University Braunschweig, 25 July 1989
- [10] **DETERMINATION OF THE BEHAVIOUR OF A CONCRETE SLAB PROTECTED WITH CALCIUM SILICATE BOARD TYPE PROMATECT®-H UNDER RWS FIRE CONDITIONS, 2004-CVB-R0114[Rev.1].**
TNO Building and Construction Research, Centre for Fire Research, Delft/Rijswijk, The Netherlands
- [11] **TECHNICAL DATASHEET PROMATECT®-T COMPOUND**
October 2003



LOST FORMWORK SYSTEM, PROMATECT®-H

PROMATECT®-H Technical Data sheet for The Palm Jumeirah Tunnel, Dubai

GENERAL TECHNICAL DATA

Designation	Calcium Silicate Fire Protective Board	
Reaction to fire	Non-combustible DIN 4102, Part 1; BS 476, part 4 EN 13501-1: A1 (Classification report WFRGent 11527C)	
Board format length x width	mm	2500 x 1250
Tolerances on length and width	mm	+/- 1
Board thickness	mm	27,5
Tolerances on thickness	mm	Minimum 27,0 Maximum 30,0
Tolerances on squareness	mm	Difference in diagonal length: A – B < 1,5
Straightness of edges	mm	Maximum gap in between two boards < 1,5
Density (nominal, oven dry)	kg/m³	870 ± 15%
Density (nominal, 23°C, 50%RH)	kg/m³	940 ± 15%
Alkalinity, pH	-	Ca. 12
Thermal conductivity, λ	W/m²K	Ca. 0,175
Water damp diffusion μ resistance	-	Ca. 20
Water absorption	g/cm³	Ca 0,57
Typical moisture content	%	5 – 10
Surface conditions	Front face: smooth, un-sanded Back face: embossed or sanded Colour: off-white	

MECHANICAL PROPERTIES

All physical and mechanical property values are averages based on standard production. The figures can change dependent on the test methods used. If a particular value is of prime importance for a specification, please contact the Promat Technical Services department.

Bending strength (average of both directions)	N/mm²	Average of production: 7.0 Minimum 95% confidence limit: 4.5
Compressive strength (typical value)	N/mm²	Perpendicular to surface: 9.3
Screw pull out resistance: screwed in the surface – 20 mm deep (typical values)	N	HECO-FIX PLUS 5,0 X 50 mm: Dry drilled – dry tested: Maximum value 727 N Minimum value 630 N Dry drilled – wet tested: Maximum value 559 N Minimum value 509 N
Anchor pull through resistance: (typical average values)	N	Fischer FNA 6x30/30 A4, with 30mm circular washer A4: Dry: 3368 N Wet: 2456 N

GENERAL DESCRIPTION

PROMATECT®-H is a non-combustible, fire protective calcium silicate board.



ADDITIONAL INFORMATION

Waste Disposal

- Refer to local legislation
- If not available: The board is not classified as a dangerous substance and so no special provisions are required regarding the carriage and disposal of the product to landfill. They can be placed in an on-site skip with other general building waste

Storage

Store on flat surface, in a dry area.

Processing and Machining

When machining the product with power tools, do not breathe dust and follow the regulatory occupational exposure limits for total inhalable and respirable dust. Wear safety goggles. Avoid contact with skin and eyes. Use dust extraction. In case of insufficient ventilation, wear suitable respiratory equipment to avoid health effects. For more information, request a Safety Data Sheet.

Board Weight Information

Thickness (mm)	27,5
Dry weight (kg/m²)	ca. 23,9
Weight 23°C, 50%RH (kg/m²)	ca. 25,9

HEAD OFFICE, Belgium

Promat International NV
Bormstraat 24
BE-2830 Tisseelt
Tel. +32 15 71 81 00
Fax +32 15 71 81 09
E-mail info@promat-international.com
www.promat-international.com
www.promat-tunnel.com

AUSTRALIA

Promat Australia Pty Ltd.
Unit 1, 175 Briens Road
AU- NSW 2152 NORTHMEAD
Tel. +61 2 9630 4922
Fax +61 2 9630 0258
E-mail mail@promat.com.au

Promat Australia Pty Ltd.
1 Scotland Road, Mile End
AU- SA 5031 ADELAIDE
Tel. +61 8 8352 6759
Fax +61 8 8352 1014
E-mail mail@promat.com.au

Promat Australia Pty Ltd.
3/273 Williamstown Road
AU- VIC 3207 PORT MELBOURNE
Tel +61 3 9645 3866
Fax +61 3 9645 3844
E-mail mail@promat.com.au
www.promat.com.au

AUSTRIA

Promat Ges.m.b.H.
Seybelgasse 13
AT-1230 WIEN
Tel. +43 1 865 45 01
Fax +43 1 865 36 00
E-mail office@promat.at
www.promat.at

BELGIUM

Promat NV SA
Kuiermansstraat 1
BE-1880 KAPELLE-OP-DEN-BOS
Tel. +32 15 71 33 51
Fax +32 15 71 82 29
E-mail info@promat.be
www.promat.be

CHILE

Promat Chile S.A.
Camino a Melipilla 10.803, Maipú
CL-SANTIAGO, Providencia
Santiago
Tel. +56 2 391 22 00
Fax +56 2 557 31 62
E-mail promat@promat.cl
www.promat-international.com

CHINA

Promat China Ltd. and
Promat South China (Div. Promat
China Ltd.)
Room 504, Block B, Qi Lin Plaza
13-15 Pan Fu Road
CN-510180 GUANGZHOU
Tel. +86 20 8136 1167
Fax +86 20 8136 1372
E-mail infot@promat.com.cn

Promat North China (Div. Promat
China Ltd.)
Room 1507 Building 5
SOHO Xiandaicheng No.88 Jianguo
Road
Chaoyang District
CN-100022BEIJING
Tel. +86 10 8589 1254
Fax +86 10 8589 2904
E-mail info@promat.com.cn
www.promat.com.cn

CZECHIA

Promat s.r.o.
Ckalova 22/784
CZ-160 00 PRAHA 6-BUBENEC
Tel. +420 2 3333 4806
Fax +420 2 3333 3576
E-mail promat@promatpraha.cz
www.promatpraha.cz

FRANCE

Promat S.A.S.
rue de l'Amandier B.P. 66
FR-78540 VERNOUILLET
Tel. +33 1 39 79 61 60
Fax +33 1 39 71 16 60
www.promat.fr

GERMANY

Promat GmbH
Scheifenkamp 16
DE-40878 RATINGEN 1
Tel. +49 21 02 49 30
Fax +49 21 02 49 31 11
E-mail mail@promat.de
www.promat.de

GREAT BRITAIN

Promat UK Limited
The Sterling Centre
Eastern Road, Bracknell
Berkshire RG12 2TD
GREAT BRITAIN
Tel. +44 1344 381 300
Fax +44 1344 381 301
www.promat.co.uk

HONG KONG

Promat International
(Asia Pacific) Ltd.
Room 1010, C.C.WU Building
302-308 Hennessy Road
HK-WANCHAI
Tel. +852 2836 3692
Fax +852 2834 4313
E-mail apromath@promat.com.hk
www.promat-ap.com

INDIA

Promat Int. (Asia Pac.) Ltd.
India Representative Office
Flat No. S-4, Second Floor B-87,
Defence Colony
IN-110 024 NEW DELHI
Tel. +91 11 2433 1594
Fax +91 11 2433 1595
E-mail info-india@promat-asia.com
www.promat-ap.com

IRELAND

Pomat Fire Protection – Ireland
Unit 231-232, Holly Road
Western Industrial Estate
DUBLIN 12
IR-IRELAND
Tel. +353 1 419 0437
Fax +353 1 460 8802
www.promat.co.uk

ITALY

Promat S.p.A.
Corso Paganini 39/3
IT-16125 GENOVA
Tel. +39 010 24 88 411
Fax +39 010 21 37 68
E-mail info@promat.it
www.promat.it

MALAYSIA

Promat Int. (Asia Pacific) Ltd.,
Unit 19-02-01, Level 2
PNB Damansara
No. 19 Lorung Dungun
Damansara Heights
MY-50490 KUALA LUMPUR
Tel. +60 3 2095 8555
Fax +60 3 2095 2111
E-mail info@promat-ap.com
www.promat-ap.com

Promat (Malaysia) Sdn. Bhd.
Unit 19-02-01, Level 2
PNB Damansara
No. 19 Lorung Dungun
Damansara Heights
MY-50490 KUALA LUMPUR
Tel. +60 3 2095 8555
Fax +60 3 2095 2111
E-mail info@ppromat.com.my
www.promat-ap.com

The NETHERLANDS

Promat B.V.
Zonnebaan 36
NL-3542 EE UTRECHT
Tel. +31 30 241 0770
Fax +31 30 241 0771
E-mail info@promat.nl
www.promat.nl

POLAND

Promat TOP Sp.zo.o
Ul. Przeclawska 8
PL-03-893 WARSZAWA
Tel. +48 22 212 2280
Fax +48 22 212 2290
E-mail top@promatop.pl
www.promatop.pl

RUSSIA

Promat GmbH
Repräsentanz
ul. Kantemirovskaya 58
RU-115477 MOSCOW
Tel. +7 095 325 42 68
Fax +7 095 231 79 77
E-mail promat@komplekt-moscow.ru
www.promat.ru

SINGAPORE

Promat Building System Pte Ltd.
10 Science Park Road #03-14
The Alpha,
Singapore Science Park II
SG-117684 SINGAPORE
Tel. +65 6294 9689
Fax +65 6294 9783
E-mail promavic@singnet.com.sg
www.promat.com.sg

SPAIN

Promat Ibérica S.A.
C/ Velazquez, 41 – 2 Planta
ES-28001 MADRID
Tel. +34 91 781 15 50
Fax +34 91 575 15 97
E-mail info@promatiber.es
www.promatiber.es

SWITZERLAND

Promat AG
Stationsstrasse 1
CH-8544 RICKENBACH-ATTIKON
Tel. +41 52 320 94 00
Fax +41 52 320 94 02
E-mail office@promat.ch
www.promat.ch

UNITED ARAB EMIRATES

Promat UK Limited-Export
Mac al Gurg, P.O. Box 672
UAE-DUBAI
Tel. +971 4 282 46 81
Fax +971 4 282 46 84
E-mail: nog general mail
www.promat.co.uk

Promat



Promat UK Limited

The Sterling Centre, Eastern Road, Bracknell, Berkshire RG12 2TD
Telephone: +44 1344 381 300 Fax: +44 1344 381 301 www.promat.co.uk